

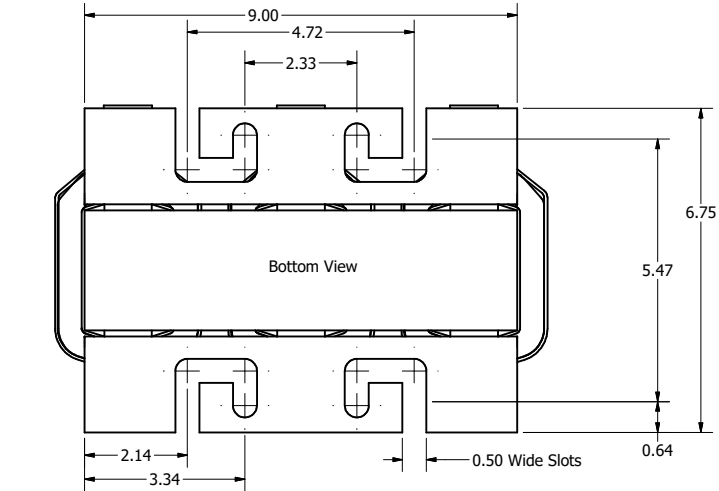
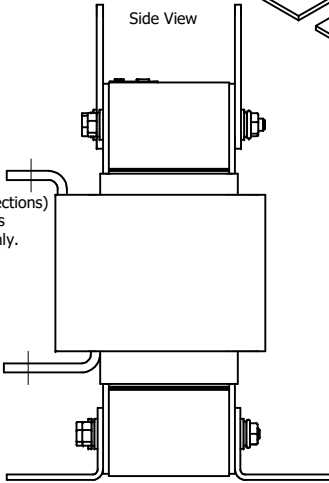
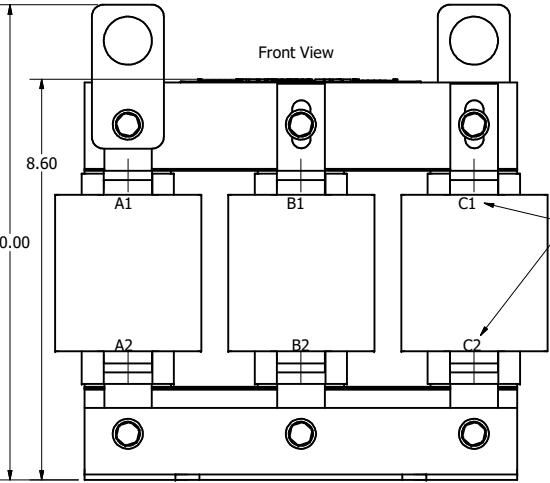
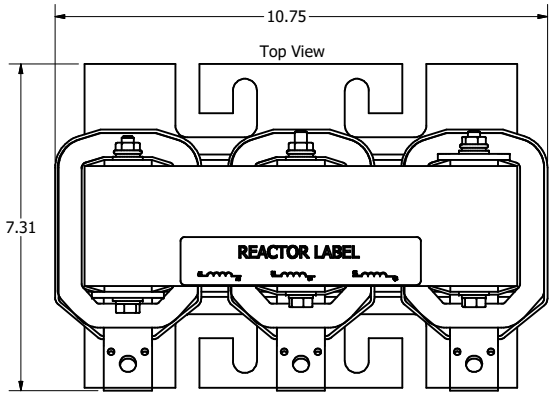


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)	Losses (W)
KDRG44H	125	125	130	371	65	SLK10	0.34	381

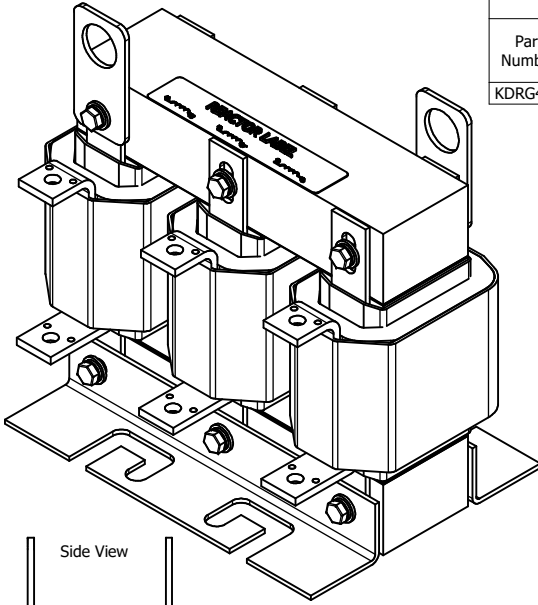

(Customer Connections) Markings On Coils For Reference Only.

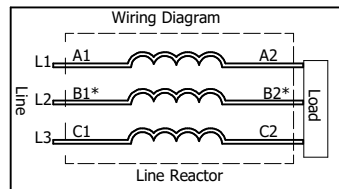

* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

TCL (800) 824-8282 transcoll.com

KDRUL Drive Reactor
 KDR- Motor Amps ---
 3PH, 3Ø/60Hz, ---V Rated, 600V Max, -A Max
 40C Amb Max, 180C Rise, RoHS
 Manual #30895 LUG KIT #SLK---

UL LISTED CE
 250-CVCS, 10, 2000

DATE CODE: A1 LUG KIT #SLK---

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 2
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 7. Material(s) Shall be RoHS Compliant
 8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .03 .XXX ± .010				W132N10611 (Rev 13 Feb 2023) Germantown, WI 53022 © 2023 TCI, LLC An Official Motors Company KDR G Frame, Copper Bus Reactor Drawing	
B	6400, Remove KDRG3H	9/1/2023	DSW	FRACTIONAL	DRN BY	DATE	107533DG		
A	Combined Drawings	3/15/17	DSW	ANGULAR	SCALE	1/2	107533DG		
NO	REVISION	DATE	BY	± 1°	SCALE	1/2	SHT 1 OF 3		