


Unit Specifications					
kVar	Harmonic	Volt	HZ.	Phase	HP
15	5TH	600	60	3	100


HGL Part Number	Schematic Drawing #	Approx Weight (LBS)
HGL0100CW3S0000	30807-S	270
HGL0100CW3C0000	30807-C	280
HGL0100SW3S1000	30807-PQ1	273
HGL0100CW3C1000	30807-PQ	283



Note: For Torque Information  
See IOM Manual

Customer Connections.  
L1, T1, L2, T2, L3, T3  
Wire Range: 1 AWG to 22 AWG.

Ground Lug  
Wire Range: 1/0 to 14 AWG.

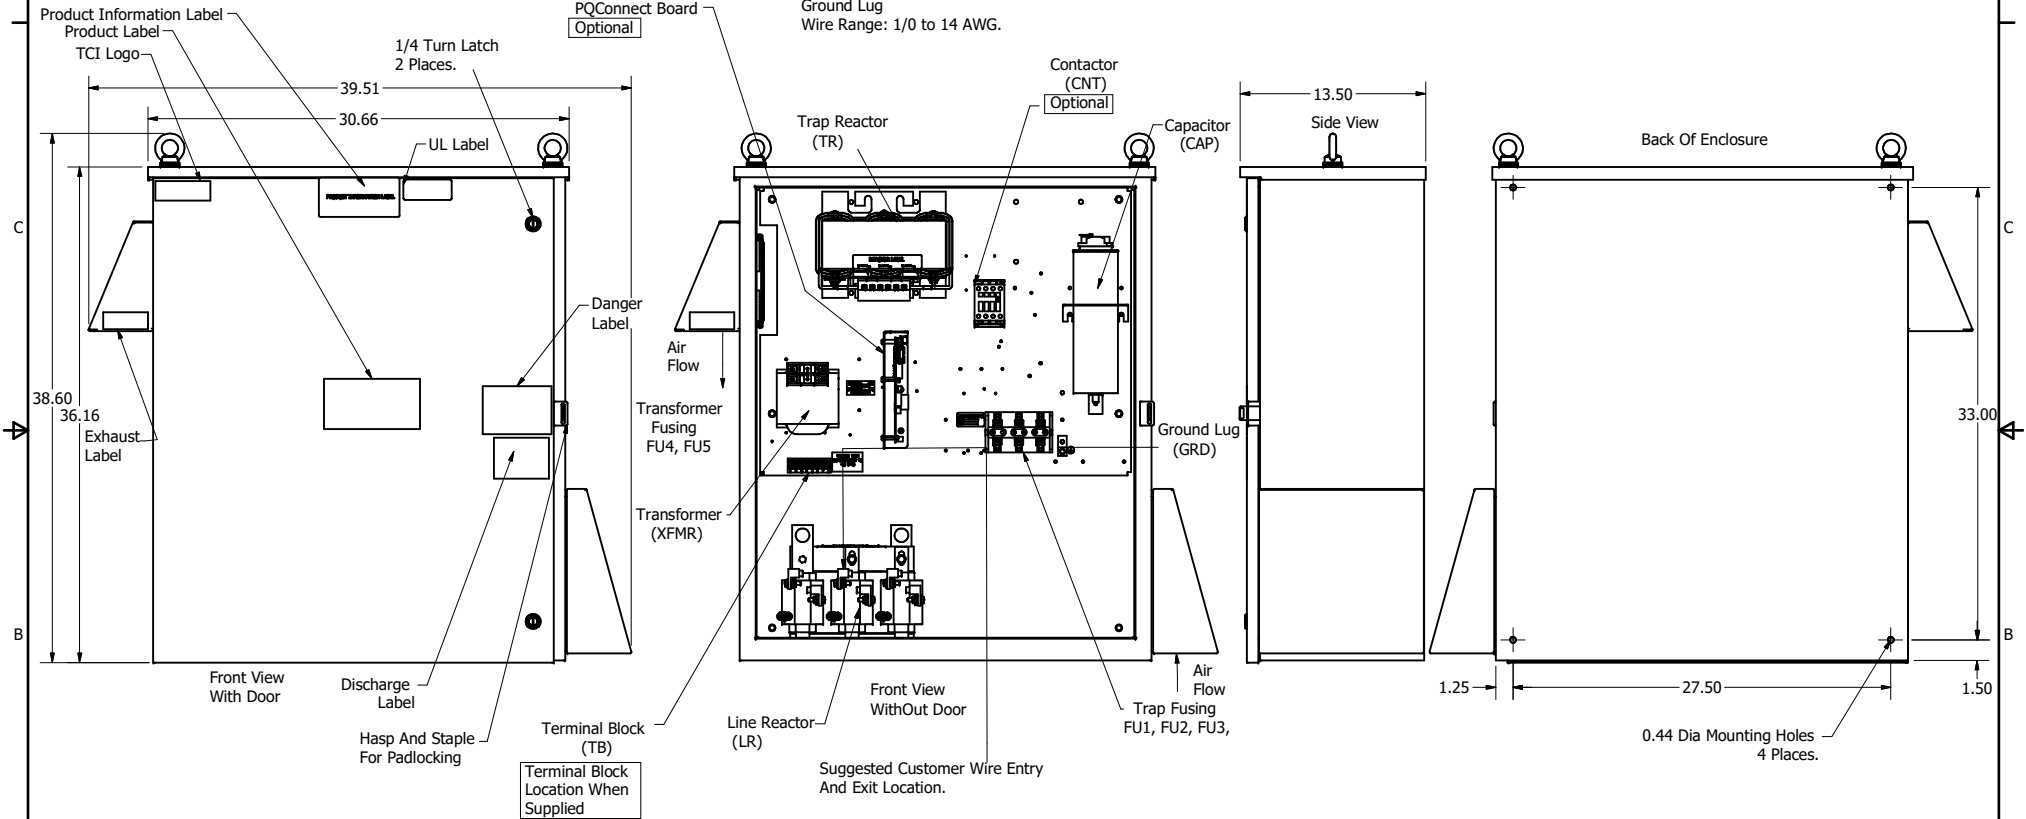

HGL0100CW3-----				
Components	S0000	C0000	S1000	C1000
Line Reactor (LR)	x	x	X	X
Trap Reactor (TR)	x	x	X	X
Capacitor (Cap)	x	x	X	X
Trap Fusing, FU1, FU2, FU3	x	x	X	X
Contactor (CNT)		x		X
Transformer (XFMR)	x	x	X	X
XFMR Fusing, FU4, FU5	x	x	X	X
PQConnect Board			X	X

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY  
WITH UL514B FOR TYPE 3R ENCLOSURES

Customer Is Responsible For Installation to  
Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10	W132 N10611 Grant Drive Germantown, WI 53022  HarmonicGuard Low Capacitance HGL, 100HP, 600/3/60, Type 3R
	C	S265, Update Enclosure	8/4/2020	DSW	FRACTIONAL ± 1/16	
	B	Add PQconnect	3/12/19	DSW	ANGULAR ± 1°	
	NO	REVISION	DATE	BY		
					DRN BY: DSW DATE: 10/4/17 SCALE: 1/8 DRAWN: [blank] FILE: [blank]	107308DG SHEET 1 OF 1