


Mounting Template for Mitsubishi FR-PU04 Keypad

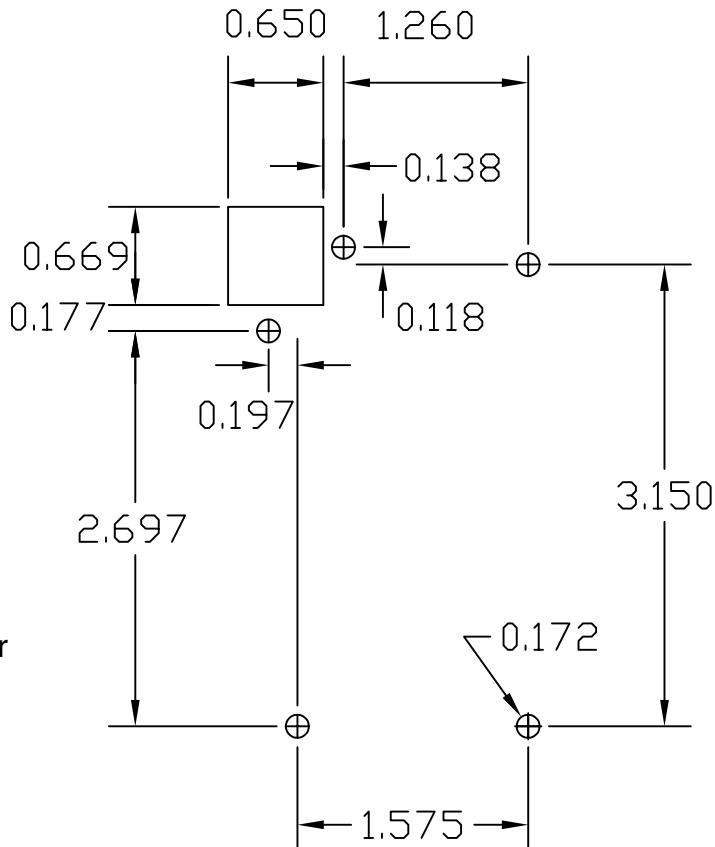

Quick Instructions

- Determine where to mount the parameter unit
- Tap one 7/8" hole (1/2 conduit knockout)
- Tap 4 holes to access metric size 3 threaded inserts on parameter unit
- Fasten the parameter unit to the panel with the screws provided
- Plug the male end of the Ethernet cable into the parameter unit